


**PLAN VIEW (SCHEMATIC)**

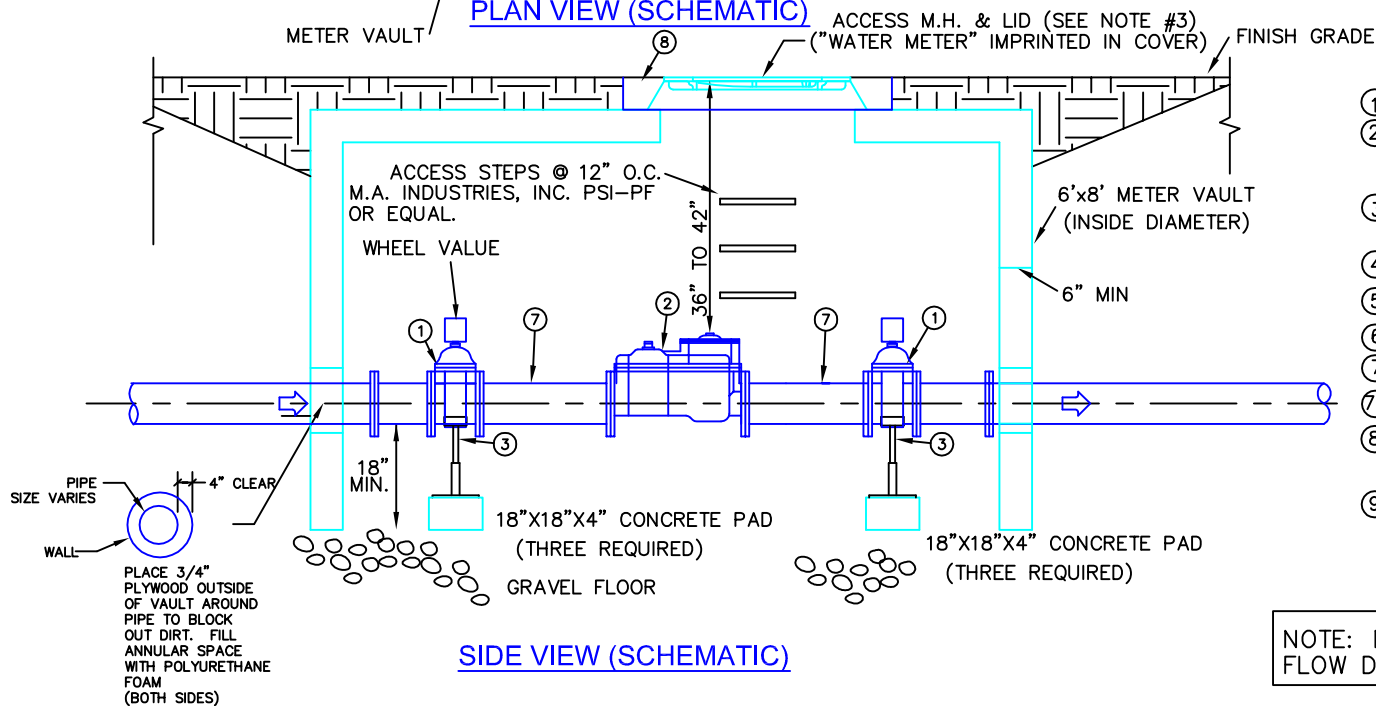

**SIDE VIEW (SCHEMATIC)**

**NOTES:**

1. ALL PIPING TO BE D.I. CLASS 350 PSI. ALL FITTINGS TO BE FLANGED.
2. ALL METER BOXES TO BE STRUCTURALLY DESIGNED FOR HS 20 LOADING.
3. 24" RING & LID TO BE D&L A1180-SP-DISH WITH HS 20 LOADING. (SEE SW-01)
4. NO GRADE RINGS WILL BE ALLOWED. TO ADJUST ELEVATION LID SHALL NOT BE THE LOW POINT IN LANDSCAPING.
5. GRAVEL FLOOR SHALL BE A MIN. OF 18" THICK.
6. IF THIS IS FOR LANDSCAPE METER ONLY - REMOVE BYPASS AND INSTALL BLIND FL ON TEES.
7. WHEN VAULT IS LOCATED IN THE ROAD, LOWER THE VAULT 12" BELOW GRADE & ADD FILL MATERIAL BETWEEN ASPHALT AND TOP OF VAULT AS APPROVED BY CITY ENGINEER.

- ① RESILIENT WEDGE GATE WITH WHEEL
- ② SENSUS OMNI C<sup>2</sup> METER WITH ELECTRONIC AMR REGISTER, PROGRAM TO READ IN 1,000 GALLON. METER IS NOT PROVIDED BY THE CITY.
- ③ SCREW JACK PIPE SUPPORT (SEE STANDARD DETAIL FIG. 11) 3 REQUIRED
- ④ FLG 90° BENDS
- ⑤ FLG TEES
- ⑥ DUCTILE IRON SOLID SLEEVE WITH MEGALUGS (MJXMJ)
- ⑦ 12" FLG SPOOLS
- ⑦A FLG X PE SPOOLS
- ⑧ CONCRETE APRON: 12" MIN, 15" MAX, 8" MIN. THICK (SEE SW-01)
- ⑨ D.I. CLASS 350 12" OUTSIDE OF BOX

NOTE: NO SPRINKLER CONNECTION OR BACK FLOW DEVICES WILL BE ALLOWED IN METER BOX.

1	RSS	UPDATE	12/1999
2	CC	UPDATE	1/2010
3	CC	UPDATE	4/2011
4	CC	UPDATE	4/2013



**STANDARD DETAIL  
FIGURE 10**

**4" OR LARGER WATER METER PIPING  
AND METER VAULT**

**SCALE: NONE**

NO.	AUTHORIZED BY	REVISIONS	DATE
-----	---------------	-----------	------